


JOB NAME \_\_\_\_\_ LOCATION \_\_\_\_\_  
 PURCHASER \_\_\_\_\_ ORDER NO. \_\_\_\_\_  
 ENGINEER \_\_\_\_\_  
 SUBMITTED TO \_\_\_\_\_ FOR: Reference Approval Construction  
 SUBMITTED BY \_\_\_\_\_ DATE \_\_\_\_\_

UNIT DESIGNATION: Schedule No. \_\_\_\_\_ MODEL NO. \_\_\_\_\_

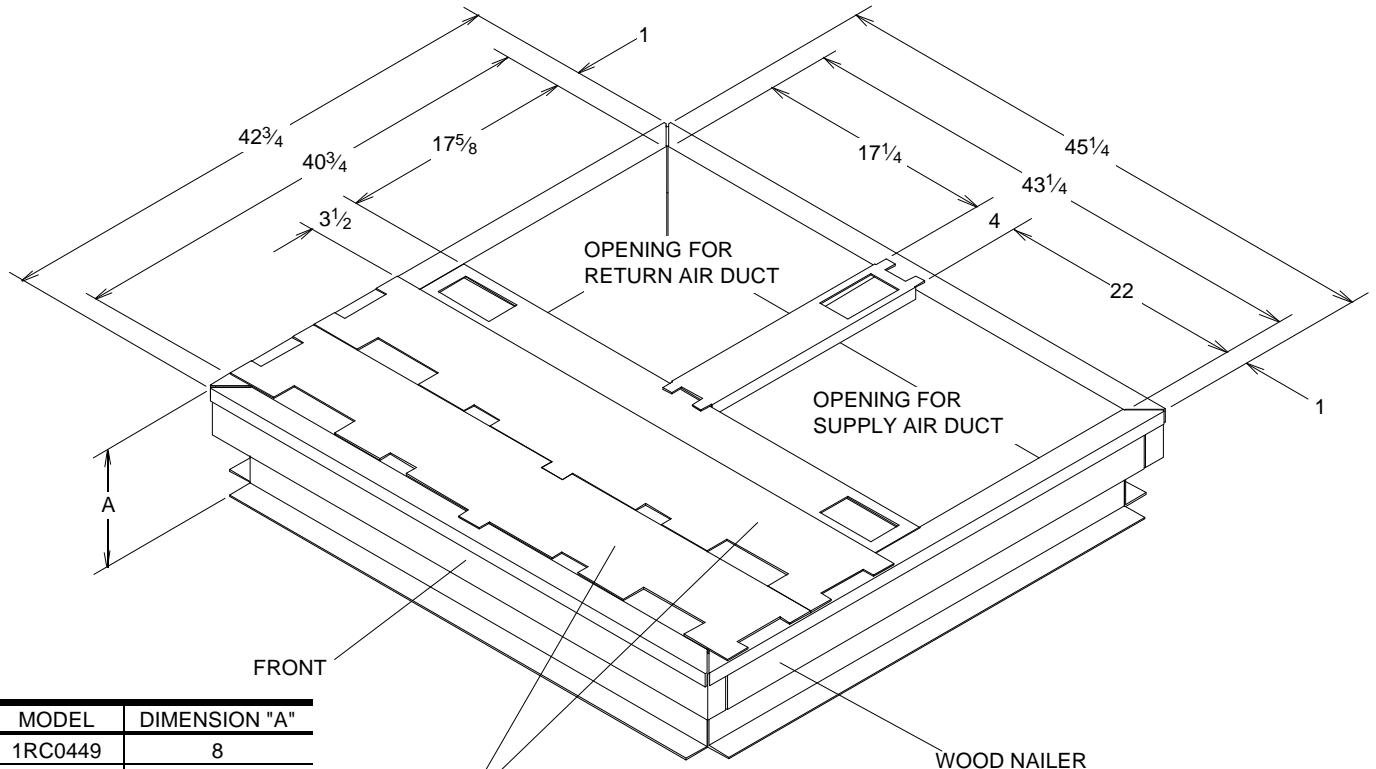

MODEL	DIMENSION "A"
1RC0449	8
1RC0463	14

INSULATED PANELS

RECOMMENDED DUCT SIZE	
SUPPLY AIR DUCT	17 1/8" x 21 1/2"
RETURN AIR DUCT	17 1/8" x 16 3/4"

NOTE:

1. Roof curb is built to NRCA standards.
2. Roof curb is constructed of 18 gauge G90 steel.
3. Unit duct supports are provided.
4. Full perimeter 1 x 4 wood nailer.
5. Curbs are shipped unassembled.
6. Corner hinge pins are used for assembly.

Roof opening; 43 1/8" long x 18 1/8" wide

Subject to change without notice. Printed in the U. S. A.

**ROOF CURB**  
**MODELS: 1RC0449 AND 1RC0463**

FOR THE FOLLOWING UNITS;  
 BHA, BHH, DEB, DEH, DNA, DNH

FORM 530.46-SD10Y (197)

Supersedes: 530.46-SD10Y (496)



Heating and Air Conditioning